

The Tata Power Company Ltd

Document No.
TPSMS/GSP/CSM/015 REV 06



Contractor's Safety Code of Conduct

Date of Issue:
15/08/2021

Contractor's Safety Code of Conduct

Reason for Change	Date of Last Revision	Prepared By	Reviewed By	Approved by
1.Simplify the procedure. 2.Addition of capability building 3.Removal of CFSA 4. Addition of Environment KPI 5.Retention amount is based on Risk involved in Job	<u>11-May-2015-R1</u> <u>15 August-2021-R6</u>	Rajesh Sharma (Head-Safety Generation)	All divisions / Chief Corporate contracts	Suresh H Khetwani (Chief safety and Environment)

The Tata Power Company Ltd		<i>Contractor's Safety Code of Conduct</i>
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

INDEX

1. Objective	3
2. Scope	
3. Definitions	3
3.1. Order Manager:	3
3.2. Site Safety Management Plan.....	3
3.3. Contractor.....	3
3.4. Emergency:.....	3
3.5. Expert Service jobs:.....	4
3.6. <u>CEO/Chief/Head of division/Unit/Utility</u>	4
3.7. Category A Vendor: Vendor	4
3.8. Category B Vendor:.....	4
3.9. Category C Vendor:.....	4
3.10. Category D Vendor:	4
3.11. High/ <i>Very high Risk Jobs</i>	4
3.12. Medium Risk Jobs:	4
3.13. Low/ <i>very low Risk Jobs</i> :	4
3.14. Long Duration Jobs:	4
3.15. High Value Jobs:	5
4. Responsibilities	5
4.1 Order Manager	5
4.2 Contractor	5
4.3 Safety Concurrence Group	6
5. Procedure:	6
5.1. <u>Vendor Registration</u>	6
5.2 <u>Bid evaluation</u>	7
5.3 <u>Capability Building. Refer safety terms and condition clause 5.2</u>	7
5.4 <u>Safety Performance Evaluation</u>	8
Appendix 1: Process Flow Chart for Vendor Registration.....	9
Appendix 2: CSM-F-2 Safety Category Qualification form	10
Appendix 3: Safety Terms and Conditions	11
Appendix 4: CSM- F-4 Safety Violation Penalty Criteria	11
Appendix 5: Process Flow Chart for issuing RFQ and PO	15
Appendix 6: CSM-F-6 Safety Competency Form (Template)	16
Appendix 7: CSM-F-7 PPE requirements	18
Appendix 8: CSM- F-8 Site Safety Management Plan / Method Statement.....	19
Appendix 9: Process Flow Chart for Safety Performance Evaluation	24
Appendix 10: CSM-F-10 Safety Potential Evaluation Criteria for Vendor Registration.....	24
Appendix 11: CSM- F-11 Safety Performance Score	28
Appendix 12: CSM-F-12 Safety Bid Evaluation Criteria.	31
Appendix 13: CSM-F-13 Safety Bid Evaluation Criteria	31
Appendix 14: Indicative List of High-Risk Jobs.....	34

The Tata Power Company Ltd		Contractor's Safety Code of Conduct
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

1. Objective

The Tata Power engages contractor workforce to execute, run and maintain various operating sites and facilities across locations for various business verticals including Generation, Transmission, Distribution and Renewable. The activities range from project execution, operation, maintenance to facilities management.

The management of contractor safety represents a significant challenge for management. Tata Power has a responsibility to ensure that contractors are provided with enough information and support to enable them to conduct their roles safely and without endangering health and safety of their own workforce or that of our staff.

To ensure reduction in reportable injuries and achieve goal of "no harm no injury", first edition of contractor safety code of conduct was launched successfully in the year 2014. Since last seven years after the launch of CSCC, Tata Power could achieve the objective of reduction in reportable injuries and fatalities.

Over the period, as the system was being matured, a need was felt to make next revision of the CSCC process. Objective of next revision is improving existing CSCC system and make it user friendly.

2. Scope: This procedure applies to all operating and project sites of The Tata Power Company Ltd and Group companies including new businesses like Electric Vehicle charging, Home Automation, Microgrid, Roof top solar etc.

3. Definitions

- 3.1. Order Manager:** Order Manager is the Tata Power representative, who has the ownership of the given job.
- 3.2. Site Safety Management Plan:** It is the safety plan agreed between Contractor and Tata Power. It will contain the entire job specific safety requirement and will be signed by the contractor.
- 3.3. Contractor:** An individual or a company that provides services to Tata Power under a signed contract.
- 3.4. Emergency:** a serious, unexpected or dangerous situation requiring immediate action, which may result in loss of revenue/property, business discontinuity. In case of Emergency*, services may be procured by selecting the qualified vendor based on the vendor category without the safety bid evaluation. It must be approved by MB level and above.

The Tata Power Company Ltd		<i>Contractor's Safety Code of Conduct</i>
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

- 3.5. Expert Service jobs:** Jobs which needs expert services of contractor which does not involve direct exposure to the potential risk or work which involves only supervisory work such as expert for turbine overhaul, expert for boiler overhaul, expert for pump and motor, expert for compressor overhaul.
- 3.6. CEO/Chief/Head of division/Unit/Utility:** Business in charge of the division who is overall custodian of the generating station or transmission division or distribution division.
- 3.7. Category A Vendor:** Vendor eligible to carry out Very High & High risk (as per Tata Power Hazard Identification and Risk Analysis Procedure) and /or Long-Term Contract related to operation and maintenance (O&M) of plant. Vendors must fulfil the requirement specified for Category A in Appendix 12-CSMF-5 of this document.
- 3.8. Category B Vendor:** Vendors eligible to carry out technical jobs, that are classified under Medium /low risk. Vendors must fulfil the requirement specified for Category B in Appendix 12-CSMF-5 of this document.
- 3.9. Category C Vendor:** Vendors eligible for to carry out low or very low risk administrative and office jobs. For this he must fulfil the requirement specified for Category C in Appendix 12-CSMF-5 of this document.
- 3.10. Category D Vendor:** All Consultants, Medical Practitioners or vendors taking job from Tata Power and working from their own premises (e.g. motor rewinding at vendor's shop floor, equipment sent for repair to vendor's works etc.) are classified as Category D Vendor
- 3.11. High/Very High-Risk Jobs:** A Job or its activities are considered as Very High or High Risk when Order manager apply the "Tata Power Hazard Identification and Risk Analysis" procedure and found safety risk associated with are under Very High or High category. Indicative lists of jobs are given in appendix 15 of this document.
- 3.12. Medium Risk Jobs:** Jobs or its activities are considered as medium risk when Order manager apply "Tata Power Hazard Identification and Risk Analysis" procedure and found the same as Medium Risk.
- 3.13. Low/Very low Risk Jobs:** Any job or its activities are considered as Low or Very low risk while Order manager, calculate it by applying "Tata Power Hazard Identification and Risk Analysis" procedure and found it under Low or Very Low category.
- 3.14. Long Duration Jobs:** When the duration of job is 12 months or more, it is considered as Long duration job

The Tata Power Company Ltd		Contractor's Safety Code of Conduct
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

3.15. High Value Jobs: When the value of the job contract is Rs. One Crore or more it will be considered as High value job.

4. Responsibilities

4.1 Order Manager: Order Manager is the Tata Power representative, who is responsible for:

- 4.1.1 Finalizing the Site Safety Management Plan along with Contractor, Safety Concurrences Group, Divisional Safety Head and Expert (External or Internal) if required.
- 4.1.2 Ensure 100% safety capability building L1, L2, L3 for contractor work force and supervisor before start of Job
- 4.1.3 Ensure Contractor safety revalidation test for all work force quarterly.
- 4.1.4 Supervise and ensure work is carried out as per the Site Safety Management Plan including agreed Risk Assessment (HIRA/JSA) and Method Statement.
- 4.1.5 Conduct audit and evaluate Safety Performance of contractor.
- 4.1.6 Ensure contractors adhere to all statutory provisions.
- 4.1.7 In case any deviation is needed in agreed safety management plan or in CSCC process for execution of job, Management of Change procedure will be applicable, and approval may be obtained from divisional head /Cluster head.

4.2 Contractor: The person, entity or organisation who is executing the job for Tata Power under a contractual agreement and will be responsible for the following

- 4.2.1 To follow all Tata Power Critical Safety Procedure, Rules and guidelines given in Safety Terms and Conditions
- 4.2.2 Undertake job as per Site Safety Management Plan CSM-F10 and method statements agreed with Tata Power.
- 4.2.3 Ensure 100% safety capability building L1, L2, L3 for contractor work force and supervisor before start of Job
- 4.2.4 Ensure Contractor safety revalidation test for all work force quarterly.
- 4.2.5 Raise any concerns regarding their work and its safety with the Tata Power Order Manager.
- 4.2.6 Report all injuries, near misses, unsafe acts/conditions, and occurrences to the Tata Power Order Manager immediately.
- 4.2.7 Ensure that all sub-contractors follow the Tata Power Safety Procedure and agreed Site Safety Management Plan CSM-F10.
- 4.2.8 To follow all statutory requirements as per the laws of the land.
- 4.2.9 All vendors applying for A category jobs or submitting quote for high risk jobs shall obtain certificates of ISO 9001, ISO14001 and ISO45001 before submitting quote for high risk Jobs.

The Tata Power Company Ltd		Contractor's Safety Code of Conduct
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

4.3 Safety Concurrence Group: It is Cross Functional Team of heaving representatives from Execution department, Divisional safety and Corporate / Divisional contracts. SCG will be responsible for the following

- 4.3.1 Assessment of Safety Potential of new vendor before registration as per CSM-F1-Safety Category Qualification Form.
- 4.3.2 Safety Evaluation of the bids as per evaluation format CSM-F-9 Safety Bid Evaluation Criteria
- 4.3.3 Finalization of the Site Safety Management Plan CSM-F-10 submitted by the contractor.

Corporate Safety Team / Cluster Safety Head will be part of SCG during Safety Bid Evaluation for following types of jobs

High-Risk jobs to be carried out in Annual Overhaul / Major Shutdowns and Outages.
Capex jobs of High-Risk Category

5. Responsibilities

5.1 Vendor Registration

For Vendor Registration, Corporate Contract will issue following documents for evaluation of contractor's safety capability

- 1) CSM-F1 –Safety Category Qualification Form
- 2) Safety Terms and Conditions

The document Safety Terms and Conditions provides the information about Tata Power safety System to the contractor. Contractor will submit the CSM-F1- Safety Category Qualification Form with all relevant details and documents to Vendor Registration Initiator, which will in turn forward it to Safety Concurrence Group (SCG) for evaluation. The SCG will evaluate the details submitted by the contractor based on a predetermined criteria CSM-F-5 Safety Potential Evaluation Criteria for Vendor Registration and will determine the category (Category A/B/C/D) for which the contractor will be registered. As mentioned in the above criteria, a site visit may also be organized by SCG prior to registration under Category A and B. In case, the contractor does not qualify the safety criteria, the contractor will not be registered. However, he may apply afresh for registration after 6 months. Please refer Appendix 1: Process Flow Chart for Vendor Registration.

5.2 Bid evaluation

At the time of placing the Purchase Requisition (PR), Order Manager is required to declare the risk involved in the of the job (i.e. Very high/High Risk / Medium Risk / Low/Very low Risk jobs, based on the RPN in HIRA. If the Job is "Very high/High Risk" or "Long Duration", then RFQ will be attached with following documents:

The Tata Power Company Ltd		Contractor's Safety Code of Conduct
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

- 1) CSM-F7- Blank Safety Competency Form
- 2) CSM-F8- PPE requirements
- 3) Safety Terms and Conditions
- 4) Job Specific Safety Requirement (Educational and Professional Qualification, Skill & Experience Manpower, Tools and Tackles (e.g. man lifter, use of drone, use & availability of rescue kit), Work Methodology etc.)

Otherwise the RFQ will be attached only with Safety Terms and Conditions. ~~Long term and low value jobs (see definition) are exempted from the CSCC process.~~

Corporate Contracts will collect duly filled CSM-F7 Safety Competency Form along with the bid. All other stakeholders will also put their efforts to get all relevant safety data during meeting / discussions with the vendor. SCG will evaluate the document as per the CSM-F9 Safety bid evaluation criteria. If any specific condition related to Contract is required to convey to contractor, Site safety team will attach the same as Annexure for specific conditions of job and submit it to contract team along with safety bid evaluation form. Commercial bid of contractor will be considered for evaluation by contract team only if contractor is qualified in safety bid. Site Safety Management Plan, defining the complete procedure of executing the job at site will be signed by the contractor and SCG after mutual agreement. CC will attach a copy of site safety Management Plan and any specific condition of contract along with PO to the successful bidder. Please refer Appendix 6: Process Flow Chart for issuing RFQ and PO significant health and safety risk associated with it.


5.3 Capability Building. Refer safety terms and condition clause 5.2. Appropriate training such as SHE L1, L2& L3 is given to ensure that a jobholder, either supervisor or worker, is competent to do his/her job safely. The skill training is provided through TPSDI and other agencies authorized by Tata Power on the list of 15 critical Safety procedures mentioned under safety procedure. Duration of course is as specified by Tata Power. These trainings are on nominal chargeable basis and rates are decided by TPSDI from time to time. Contractor shall ensure that concerned workmen are provided with adequate training before he/she is allowed to execute the work. An evaluation test will be conducted after the completion of the training. Those workmen employee who meet the minimum required competency will be provided with Certificate (Card), which is valid for 3 years, post which the workmen have to reappear for the assessment. If the workman is not able to qualify the assessment, he/she will be given 3 additional attempts to clear in 3-month timeframe failing which he/she will not be allowed to work on high risk jobs.

5.4 Recognition to the Prior Learning in Safety: If "Order Manger" recommends and "Head of the Safety Department of division" is satisfied with the safety knowledge and competency of the employee of contractor a test (RPL) may be conducted by TPSDI / other recognised institute to assess the prior learning in safety. If employees of the contractors will pass in such test, he will be exempted from appearing in SHE L1 training.

5.5 Safety Performance Evaluation

During the time of job execution, regular site inspection will be carried out by the Tata Power officials and violations will be dealt as per CSM–F4 Safety Violation Penalty Criteria. Apart from this, monthly safety performance of the contractor will be evaluated based on the predetermined criteria as per CSM-F11 safety Performance Score and monthly score will be maintained by the Order Manager. Certain percentage of each running bill will be retained as Safety Retention amount and will be released on the basis of Safety Performance Score at certain intervals as defined in CSM- F-3- Safety Performance Evaluation Criteria. Please refer Appendix 10: Process Flow Chart for Safety Performance Evaluation. Percentage of retention amount is mentioned in safety terms and conditions.

Appendix 1: Process Flow Chart for Vendor Registration

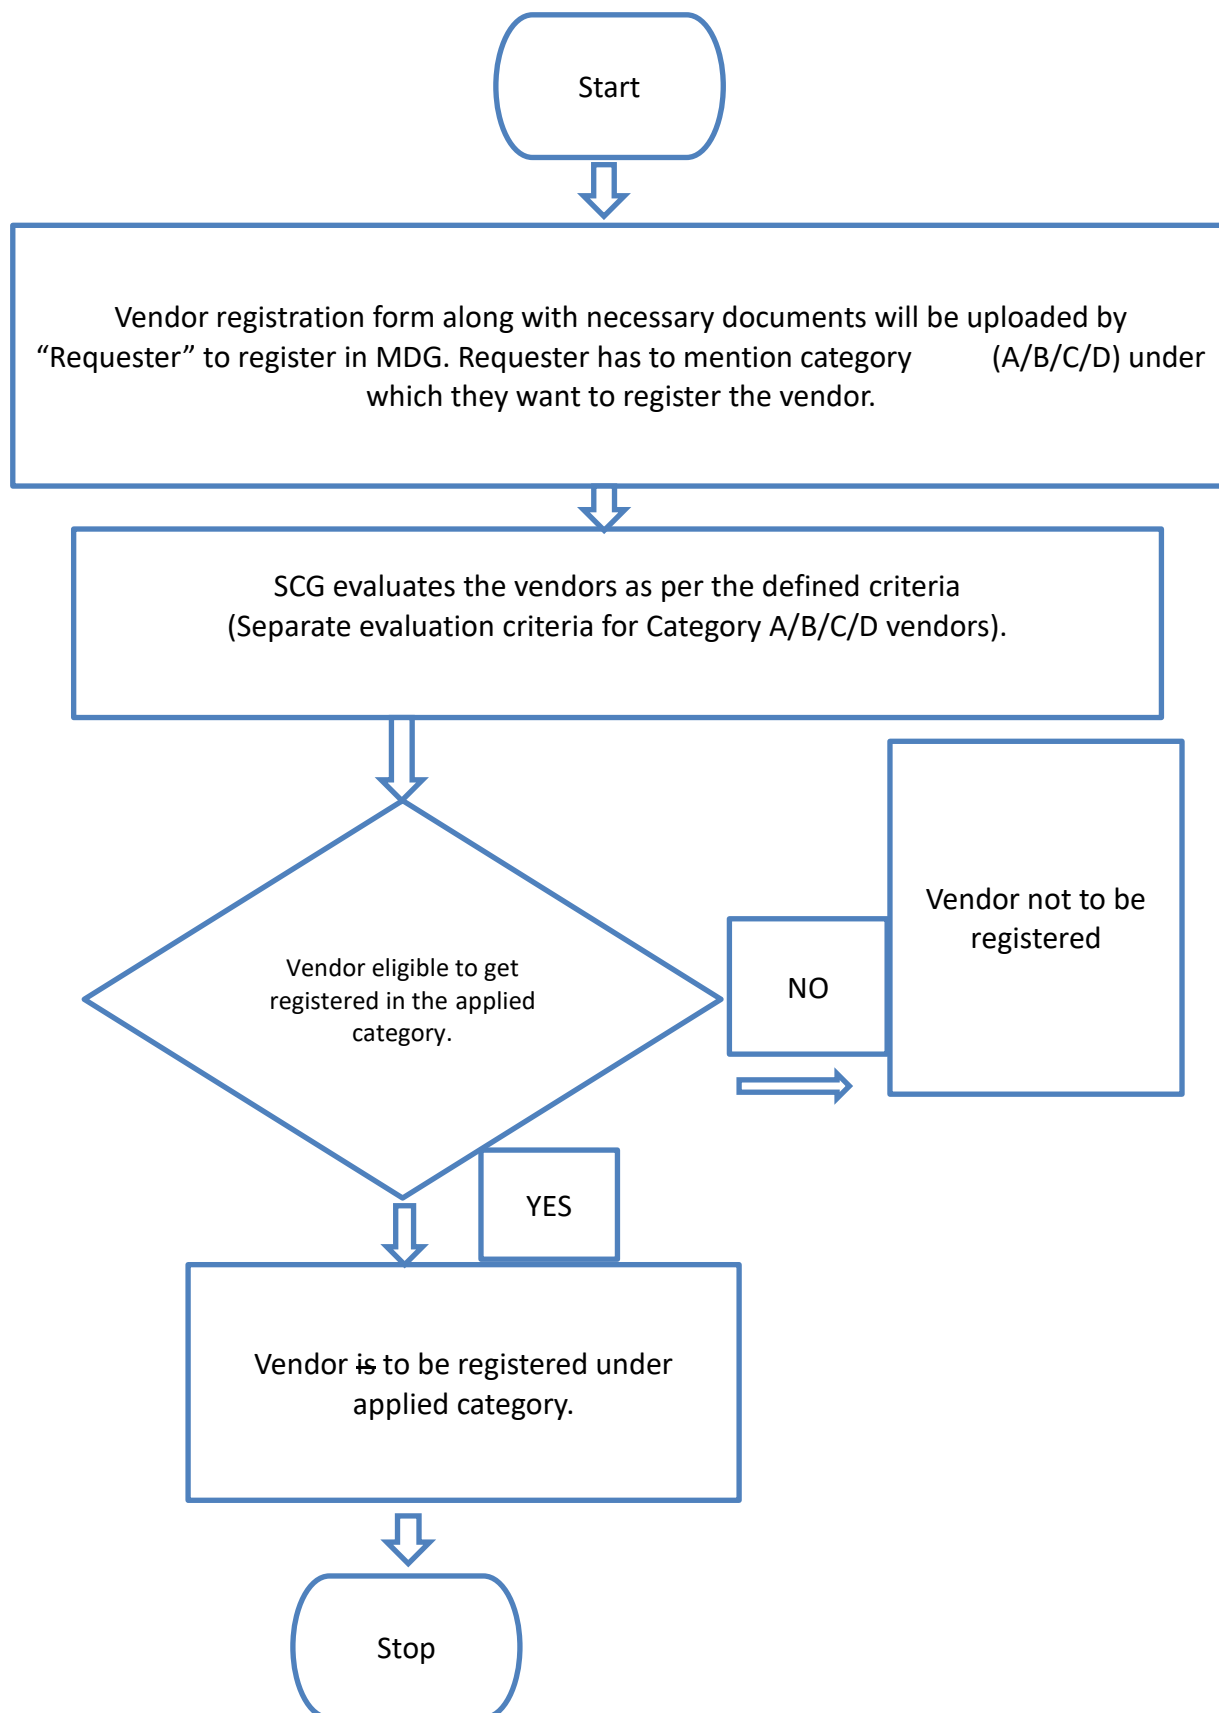

The Tata Power Company Ltd		<i>Contractor's Safety Code of Conduct</i>
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

Appendix 2: CSM-F-2 Safety Category Qualification form

1. "Safety Category Qualification Form" is part of vendor registration form. It needs to be filled by the contractor at the time of Registration and should submitted to Requester / order manager with all relevant documents.
2. The same will be evaluated by Safety Concurrence Group as per the criteria given in CSM-F-5.
3. Information provided by contractor will be verified during site visit

Safety Category Qualification Form

(to be filled by the vendor)

Please Consider my application for

Category A Vendor: Vendor eligible to carry out Very High- and High-risk O&M jobs

Category B Vendor: Vendors eligible to carry out technical jobs, classified as Medium / low risk

Category C Vendor: Vendors eligible for to carry out low or very low risk administrative and office jobs

Category D vendor: All Consultants, Medical Practitioners or vendors taking job from Tata Power and working from their own premises.

Register me/us to do following Job(s):

- 1.
- 2.

Name of the Vendor:						
Sr. No	Safety Information	Remarks	Attachment			
1	Certified for i. OHSAS 18001/ ISO 45001, ii. ISO: 14001 iii. ISO: 9001 (ISO certificates to be issued from reputed accreditation agencies specified by Tata Power)	i. Y/ N ii. Y/ N iii. Y/ N	Attach copy of the certification			
2	Safety Statistics for Last Three (3) Years - LTIFR - LTISR	Yes/No		Year 1 (Last FY)	Year 2	Year 3
			LTIFR			
			LTISR			
3	Do you have Safety Policy?	Yes/No	Attach copy of the safety policy.			
4	Do you have Safety training process?	Yes/No	Attach safety training process.			
5	Do you have Safety organization structure e.g. Safety Officers and Safety Committees?	Yes/No	Attach copy of the safety organization structure.			
6	Name and address of sites where work is in progress or worked earlier	Yes/No	Site details to be attached for inspection by Officials.			

Signature :

Name and Designation :

Stamp of Organization :

The Tata Power Company Ltd		<i>Contractor's Safety Code of Conduct</i>
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

Appendix 3: Safety Terms and Conditions

Please refer the attached document Safety Terms and Conditions.

Appendix 4: CSM- F-4 Safety Violation Penalty Criteria

Penalty shall be imposed on the contractors under the following circumstances for breaching the contractual agreements:


Sr No	Description of violation	Severity	Penalty
1.	Working without Permit	5	5000/-
2.	Untrained (TPSDI) worker on high-risk jobs.	5	5000/-
3.	Unhygienic/Bad condition of PPE	2	250/-
4.	Not following Tata Power Procedure & Standard	4	2000/-
5.	Unsafe Act/Condition of Severity 4	4	2000/-
6.	Unsafe Act/Condition of Severity 5	5	5000/-
7.	No Earthing of Electrical equipment	5	5000/-
8.	Damaged welding cable	5	5000/-
9.	Violation of Positive Isolation Procedure (LOTO Not followed)	5	5000/-
10.	ELCB of more than 30 mA/ELCB not working	5	5000/-
11.	On/Off switch of welding m/c not working	5	5000/-
12.	Electric cable tied with metal wire	5	5000/-
13.	Leakage found DA hose / cylinder	5	5000/-
14.	Use of LPG	5	5000/-
15.	Use of IC engine-based Three-wheeler at the work site.	5	5000/-
16.	Starting the job without Toolbox Talk	5	5000/-
17.	Spatter falling on DA hose / Gas-line/ pathways / Equipment	5	5000/-
18.	No safety latch in crane hook	5	5000/-
19.	Load raised or swung over people or occupied areas of buildings	5	5000/-
20.	Persons standing in swing area of construction equipment.	5	5000/-
21.	Using damaged slings.	5	5000/-
22.	Unstable scaffolding/nonstandard Scaffolding in use	5	5000/-
23.	Handrails and mid-rails are missing	5	5000/-
24.	Safety Harness not anchored with lifeline/fixed structure	5	5000/-
25.	Fall arrestor not provided/ Not being used.	5	5000/-
26.	Double lifeline not used for working at height	5	5000/-
27.	No rubber mat in Electrical Distribution (DB) room	4	2000/-
28.	Water found accumulated in Electrical Distribution room/near welding machine.	4	2000/-
29.	Inserting electric cables into socket, without using plug.	4	2000/-
30.	Use of damaged electrical cable/two core cables.	4	2000/-
31.	Inflammable material found in Distribution Room / welding areas.	4	2000/-
32.	Loose material falling into excavated pit	4	2000/-
33.	Water logging into excavated pit /trenches	4	2000/-

34.	No / inadequate Barricade	4	2000/
35.	Undercut / cave-in found on sides of excavated pits	4	2000/
36.	Grinding wheel/ Coupling/ Piling winch/other rotating parts without guard	4	2000/
37.	The HMV/Mobile Crane operator does not have a valid HMV driving license.	4	2000/
38.	The loading area is not leveled properly.	4	2000/
39.	Ladder not anchored at top	4	2000/
40.	Opening found in working platform of scaffolding/floor	4	2000/
41.	Inadequate illumination at the working area	4	2000/
42.	Loose material lying on Gantry, platform	4	2000/
43.	Cleaning with Compressed Air.	3	500/-
44.	Gas Cylinders using without cap.	3	500/
45.	Gas Cylinders stored without securing	3	500/
46.	Bringing inside any other chemicals, apart from approved by Safety dept.	3	500/
47.	Using drum for sitting or accessing height.	3	500/
48.	Misusing emergency facilities like fire hydrant line/ hose box/ spray system/ eye wash etc.	3	500/
49.	No provision of Safety net where falling materials or tools may occurs	3	500/
50.	Taking electrical supply from non-designated outlet (other than socket).	3	500/
51.	Restricted gangways due to unwanted materials.	3	500/
52.	Not reporting incident.	3	500/
53.	Entering into restricted area like switch yard/ hazardous storage	3	500/
54.	Work without supervision	3	500/
55.	Parking of vehicle without applying wheel choke at right front-front and left rear-rear wheels other than passenger cars.	3	500/
56.	Heavy Vehicle without helper or co-driver.	3	500/
57.	Not wearing florescent safety jacket at site.	3	500/
58.	People travelling in load body of vehicle.	3	500/
59.	Parking of vehicles at non designated area.	3	500/
60.	Shifting heavy materials without guide ropes.	3	500/
61.	Using other than 24V lamp inside the confined space/Use of other than 24V lamps.	3	500/
62.	Angular loading/ lifting with Crane or hoist.	3	500/
63.	By passing the limit switch/ Safety Interlock.	3	500/
64.	Housekeeping activities on road without proper barricade.	3	500/
65.	Trying to board or alit from running vehicle.	3	500/
66.	Cylinder Valves of Gas cylinders not closed when not in use.	3	500/
67.	Flash-back arrester not used.	3	500/

68.	Hand Trolley wheel found damaged.	3	500/-
69.	Guy ropes of required length on both sides of object are not used during movement with load.	3	5/ 00/-
70.	Scotch block/wedge not provided, when the vehicle is parked.	3	500/-
71.	Suitable Trolley not provided to hold the cylinders.	3	500/-
72.	Locked First Aid box	3	500/-
73.	Caution boards, danger signs (luminescent /red) along with emergency contact number are not found displayed.	3	500/-
74.	Person found jumping barricading tape	3	500/-
75.	Stacking of pipes, pile casing, drums without chock blocks/wedges	3	500/-
76.	The terrain on which Heavy Equipment/Machinery moves is not reasonably hard.	3	500/-
77.	Without Safety Helmet at working sites	4	250/-
78.	Without Crash Helmet (on bikes)	4	500/-
79.	Without Full body double lanyard Safety Harness (for work at height)	5	5000/-
80.	Without Hand gloves - Material Handling, Welding, Cutting,	4	100/-
81.	Without Safety goggles/ face shield - Welding/Cutting /Grinding	5	5000/-
82.	Handling Chemical without PVC Apron	5	5000/-
83.	Smoking in prohibited area (e.g. Godown / Warehouse / Store of flammable material etc. / Area prone to dust explosion)	5	1000/-
84.	Sleeping at Workplace	3	100/-
85.	Driving beyond speed limit	3	1000/-
86.	Seat Belt While Driving (for front seat passengers and driver)	3	500/-
87.	Driving without license	4	1000/-
88.	Heavy Commercial vehicles without reverse horn	3	500/-
89.	Nonfunctional Head light/ taillight and side indicators	3	100/-
90.	Using Mobile Phone During Driving	5	5000/-
91.	Poor visibility of registration number/ without registration number	3	100/-
92.	Broken/ without Side view mirror	3	100/-
93.	Over speeding above specified limit	3	500/-
94.	Broken/ Without Pressure gauge on Oxygen/ LPG / Acetylene cylinder.	3	500/-
95.	Without Flash back arrestor on Industrial Acetylene & Oxygen cylinders.	5	5000/-
96.	Spillage of hazardous material/chemicals during transportation	4	2000/-
97.	Electrical equipment without Earthing/ ELCB/ Double Insulation Cable.	5	5000/-

98.	Lifting Tools & Tackles used without/ expired Test Certificates.	5	5000/-
99.	Housekeeping repeatedly not maintained		
100.	• First Time	3	Warning
101.	• Second Time	4	1000/-
102.	• Third Time	5	5000/-
103.	Serious Violation of House Keeping (after 1st or 2nd warning to be decided by Project Manager depending on the severity)	5	Rs.10000/- and above
104.	Repeat Violation of same nature	5	5 X Penalty for Violation
105.	Appointment of subcontractor without his Safety Bid Evaluation and/or without the permission of engineer in charge or Order manager.	5	5% of Contract Value

Appendix 5: Process Flow Chart for issuing RFQ and PO

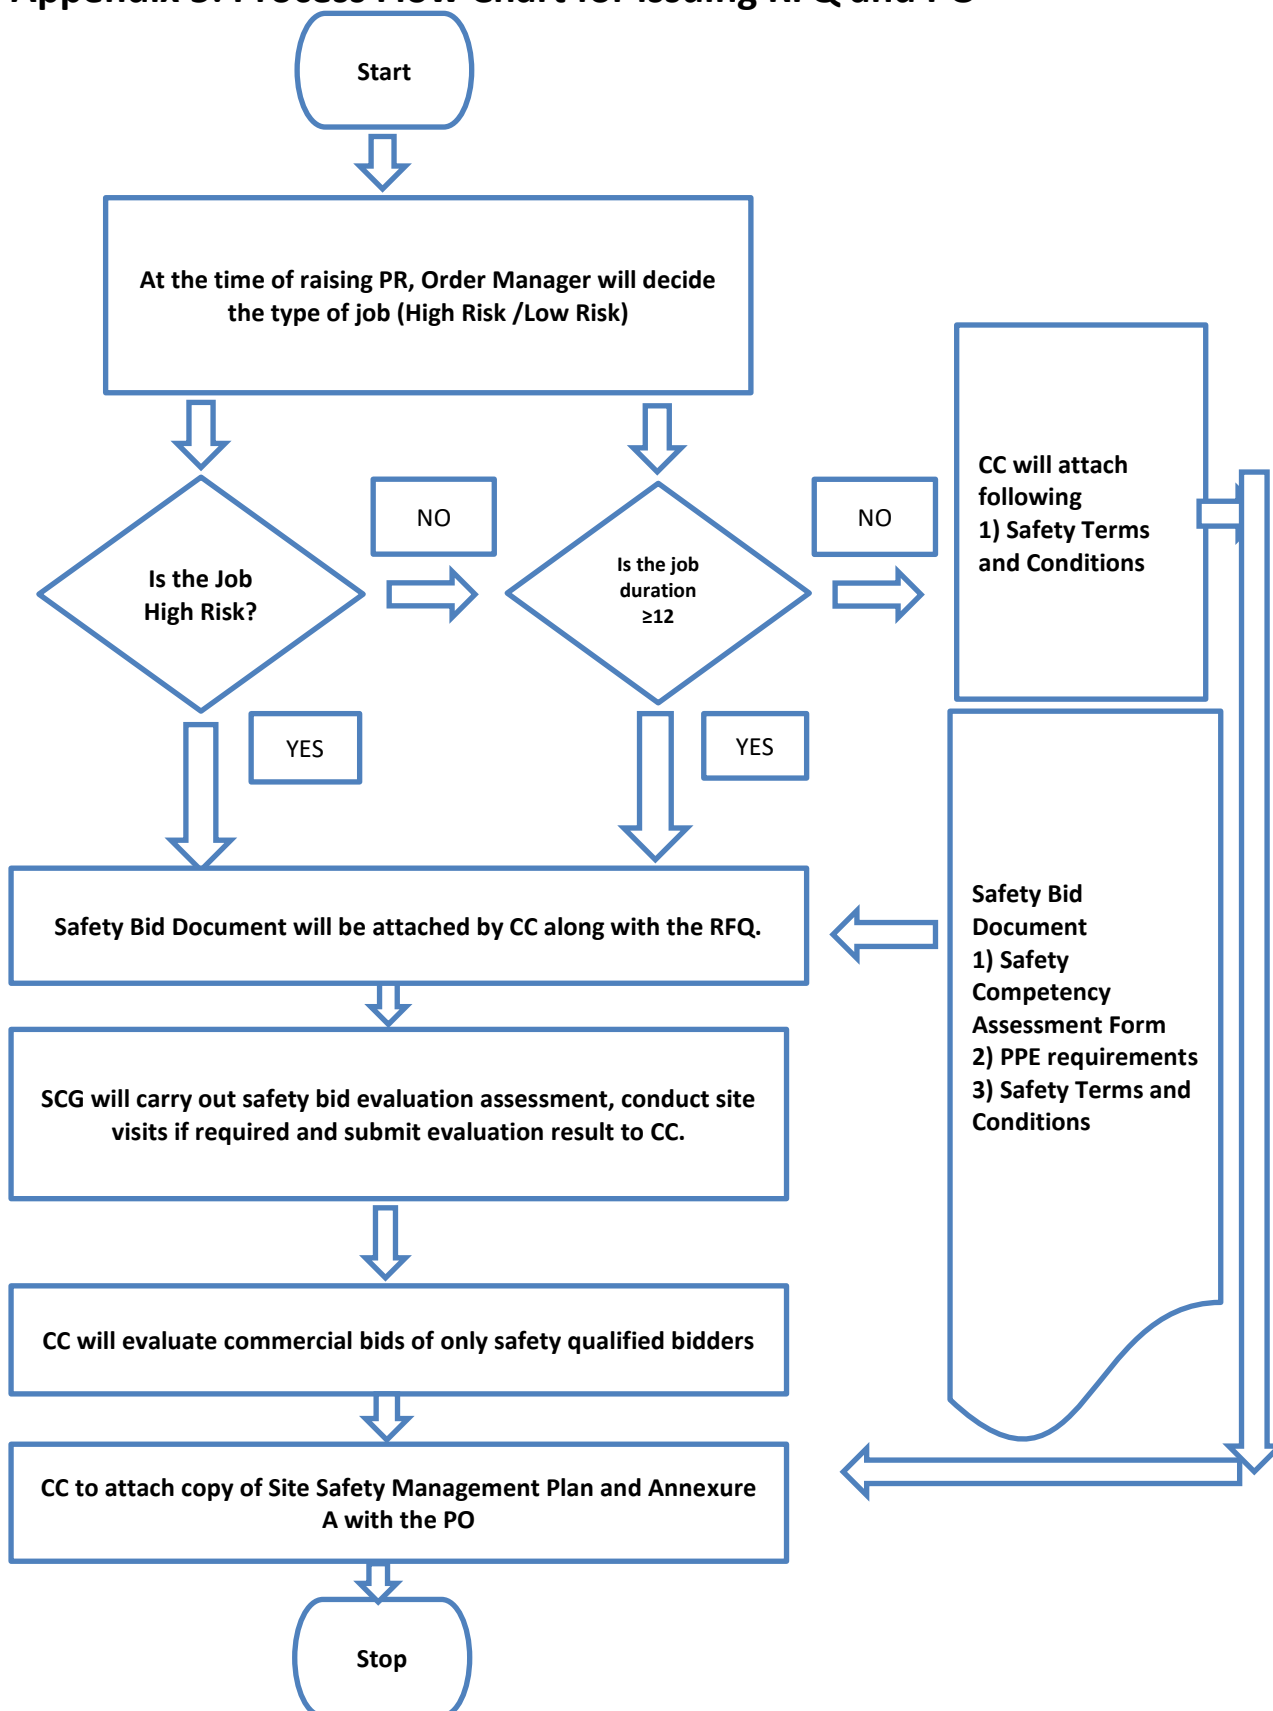

The Tata Power Company Ltd		<i>Contractor's Safety Code of Conduct</i>
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

Appendix 6: CSM-F-6 Safety Competency Form (Template)

Name of the Vendor/Bidder : -

Name of the Sub Vendor (If job is given to Sub Vendor) : -

Description of the Job : -

Request for Quotation (RFQ) No. :-

Vendor/Bidder to mandatorily provide the below safety competency related information.

1. Proposed Manpower Deployment Schedule : -

Category of Manpower Deployed	Minimum Qualification & Experience	Proposed Numbers against each category month-wise			
		Month 1	Month 2	...	Month n
Project Manager					
Site-In-Charge (Site Manager)					
Shift-in-Charge					
Safety Officers					
Supervisors					
Technicians					
a.....					
b.....					
Highly Skilled Workmen					
a.....					
b.....					
Skilled Workmen					
Semi-Skilled Workmen					
Unskilled Workmen					
Total Manpower					

Instructions to Bidder to fill:

- Bidder to provide the overall site manpower deployment schedule as above.
- Bidder to indicate (through colour code mentioned below) their direct and sub-contracted employees

Direct bidder employee

Partly Direct / Partly sub-contracted

Sub-Contracted

- Against each of the category, bidder to indicate the minimum qualification and experience of the proposed manpower.
- Rows can be added to also identify other specialised manpower e.g. specific details to be included for high risk activities operators
- Columns can be extended to the actual duration of Site activities.
- Bidder to note that if operations is in shifts, then Shift-in-charge / safety officers are required for each shift of operation.

2. List of Tools, Tackles, Machines and Equipment: -

Bidder/ Vendor to provide the list of tools, tackles, equipment **to be used during the job / project execution**. Bidder/Vendor to ensure that all the lifting tools and tackles, pressure vessels are duly certified by the competent person authorised by the Chief Inspector of Factories of the respective state prior to start of the job

The Tata Power Company Ltd		<i>Contractor's Safety Code of Conduct</i>
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

Sr. No.	Description of Tools / Tackles	Capacity / Rating	Quantity	Make	Remarks
1					
2					
3					
4					
5					
6					
7					
...					

3. Safety Records:

Bidder to provide the details of fatalities and lost workday cases (LWDC), occurred in last three years (data to be provided for the last completed FY and preceding 2 years).

Description	Safety Data for Last 3 Years		
	Year 1 (Last FY)	Year 2	Year 3
	20 -	20 -	20 -
Fatalities (Nos.)			
Lost Workday Cases (Nos.)			

In case of no fatalities, LWDC during any year, the form may be filled stating NIL against the respective year. Bidders are encouraged to also submit the RCA / incident investigation reports and the learning's implemented out of the above reported incidents

4. Job Safety Plan/ Method Statement:

Bidder to provide / enclose a detailed Site/Job Safety Plan along with a Method statement detailing the execution philosophy (how the bidder intends to execute the Job/Project), identifying all key activities which are required to be performed by the contractor at Site. Bidder to also list down all high-risk activities and provide the Hazard Identification and Risk Assessment (HIRA) for all such high-risk activities involved in the site work.

(Use Method Statement template attached as annexure A and sample as attachment B)

5. Management System Certification: -

Sr.	Certification	Yes / No	If Yes, Year of Certification	If No, Target date for Certification
	ISO 9001			
	ISO 14001			
	OSHAS 18001 / ISO 45001			
	Any other (please specify.....)			

Note: Please attach certificates to support above. In case not accredited for above but applied for, application letters may be attached.

The Tata Power Company Ltd		<i>Contractor's Safety Code of Conduct</i>
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

Appendix 7: CSM-F-7 PPE requirements

The Contractor shall ensure that the following PPE of Approved standards shall be available at all time and shall be used by his employees with no exception whatsoever.

1	All contractor's employees at site	Safety Florescent Jacket (orange color), Safety helmet & safety shoes with Composite or steel toe cap
2	Workers mixing asphalt, cement, lime / concrete	Safety goggle & protective Hand gloves and footwear, Nose mask.
3	Welders / Grinders	Welding screen/goggles, safety shoes, leather hand gloves, aprons, leg guard
4	Stone breaker	Protective goggle, hearing protection, anti-vibration hand gloves and Protective clothing.
5	Electricians/ <u>Line man</u>	Rubber hand gloves & Electrical resistant shoes.
6	Workers engaged in insulation using glass wool etc.	Respiratory mask & leather Hand gloves, goggles.
	Workers engaged in coal handling plant, ash handling plant and working in high dust area.	Dust mask, Hand gloves, protective goggles.
7	Workers working at a height of 1.8 Meter or above.	Double lanyard full body harness, fall arrestor and safety net made of reinforced nylon fiber ropes firmly supported with steel structures

- PPE shall be conforming to BIS/DGMS/DIN specifications, in good condition and shall be comfortable to his employees, when used.

The Tata Power Company Ltd		<i>Contractor's Safety Code of Conduct</i>
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

Appendix 8: CSM- F-8 Site Safety Management Plan / Method Statement

Site Safety Plan / Method Statement (Template)

This Method Statement describes the specific safe working methods which will be used to carry out the described work. It gives details of work procedure with control measures to counter health and safety issues related to this work. The listed content of this Method Statement can be changed/modified subjected to job scope / specifications, but task specific method statement once finalized & approved, that should not be modified during work execution without permission from the approving authority.

Project/Job Name			
Scope of work: -			
Drawing References: -			
Detail of Sub contractors involved: -			
Method Statement Prepared By: - Designation: - (e.g. Site Manager)	<u>Signature</u>		<u>Date</u>

1.0 Introduction *(Describe purpose of the work, give details of type and scope of work being carried out);*

--

2.0 Location of Work *(Give site address and precise location on site where work is to be carried out.)*

--

3.0 Safety Document /Specific Approval Required *(Details of any safety documents or specific approval i.e. Client specific approval required to undertake the work)*

--

The Tata Power Company Ltd		<i>Contractor's Safety Code of Conduct</i>
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

5.0 Role & Responsibilities of Personnel/Parties Involved in activities: -Clearly define role and responsibilities of all personnel involved in activity i.e. Site management staff including subcontractors' parties- Main contractor Project/Site Manager, Sub Contractor Site Manager, Project Engineer, Safety officer, Competent Supervisory Staff)

--

6.0 Working/Activity Description: - *It is important that all operatives should have clear idea of those operational sequences and responsible supervisor must verify their competency prior to their engagement in operation.*

6.1 Pre-Working Checks

--

6.2 Resources (Equipment, tools including manpower) Details *i.e. Equipment and Tools, specific operational equipment, test kits, lifting resources, Details of materials to be used in operation, including any reference to COSHH assessments in case of use of any chemicals, Details of the manpower allocated to the task, e.g. titles, qualifications, competences, direct manpower, contractors. Details of plant, tools and equipment to be used for the work, including the availability of relevant statutory documents, checks or inspections etc. Details of fencing, barriers, cones, chains, dangers notices, warning signs etc.*

Tools required for work:

Sr.No	Tools /Equipment /Machine	UOM	Required Qty.	Remark
1				
2				
3				
4				
5				
6				
7				
8				
9				
10				

6.4 Operational Sequence of work: - Full description of the work, setting out the methodology in a sequential manner, including any reference to any identified operational restraints. Also refer here sec. 5.0 responsibilities part for every step of work sequence).

Sr.No	Activity	Details of job sequence	Risk Involved	Control Checks
1.		1.		
2.				
3				
4				
5.				

6.7 Final Checks & restoration of work area after completion of work :- Those checks to be carried out by responsible supervisor in witness of his line hierarchy by use of specific checklist of certain operational checks and once those completed satisfactory, PTW (if applicable) to be closed and isolation arrangements to be restored by removing barricades/cautionary tags.

7.0 Task Specific Hazards: - Refer to Task Specific Risk Assessment and attach in appendix
Attachment: - Specific Risk Assessment

In addition, please provide below control measures in risk assessment (as applicable).

Fall Protection Measures: (Where Work at height cannot be avoided)							
Control Measures for Electrical Hazards							
Others Hazard if any (please provide details)							
Hazardous Substances to be used in job : (Attach MSDS if required)	 Acute Toxic	 Health Hazard	 Corrosive	 Dangerous For the environment	 Oxidising	 Highly Flammable	 Explosives
	Yes /No	Yes /No	Yes /No	Yes /No	Yes /No	Yes /No	Yes /No

7.0 Emergency Provisions: -Relevant operational possibility of a programme in the case of emergency situation i.e. electrical supply restoration. In addition emergency response provisions i.e. first aiders, fire fighting, and first aid arrangements, nearest onsite/offsite emergency response also to be considered during emergency planning.

--

The Tata Power Company Ltd		<i>Contractor's Safety Code of Conduct</i>
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

8.0 "5S issues" / Waste Disposal/ Housekeeping and Environmental issues: -*Details waste disposal processes and or housekeeping activities, Details of environmental impacts and control measures.*

--

9.0 Personal Protective Equipment (PPE):- (*Tick on PPE requirements for the task/Job*)

Required Personnel Protective Equipment:							Other: 1. Hi-Viz 2. Coveralls 3.
	Safety Boots	Hard Hats	Safety Gloves	Hearing Protection	Eye Protection	Respiratory Protection	


10.0 First Aid facilities and Nearby Hospitals Details

	Name of On-Site First Aider:	
	First Aid Box Location:	
	Location of Nearest Hospital:	

11.0 Occupational Health, Fitness and COVID-19 related Preparedness:

- Please give a brief writeup / methodology of your organization planned to avoid impact of the COVID-19 pandemic at Tata Power working site.
- Please give brief details of occupational health and hygiene related interventions planned by your organisation to ensure good health and fitness of workforce at Tata Power site.

Appendix 9: Process Flow Chart for Safety Performance Evaluation

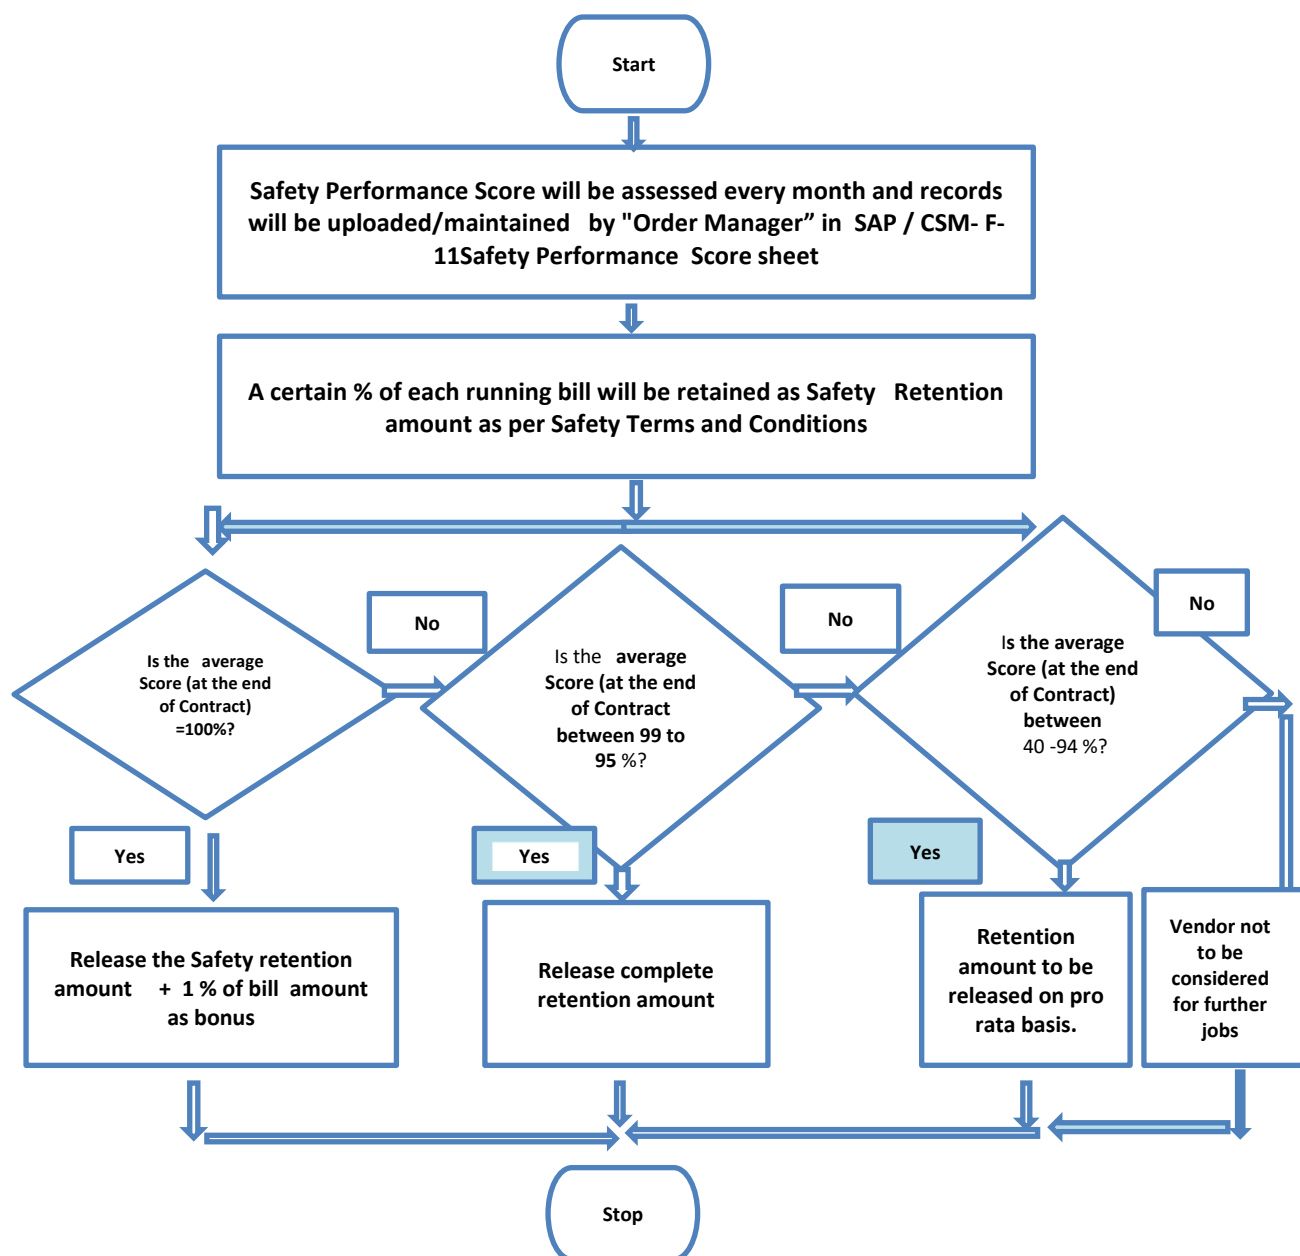

Appendix 10: CSM- F-10- Safety Performance Evaluation Criteria

1. A certain percentage of the bill value will be retained against every running bill as safety performance retention. The amount will be released with the last invoice or every six-month based on Safety Performance Score of contractors. The retention amount will be calculated based on contract value as below.

<u>Contract Value</u>	<u>Retention Amount (%)</u>
-----------------------	-----------------------------

The Tata Power Company Ltd		Contractor's Safety Code of Conduct
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

<u>Very high/High risk job</u>	<u>2.5</u>
<u>Medium Risk jobs</u>	<u>2</u>
<u>Low/Very Low Risk jobs</u>	<u>1.0</u>

2. The evaluation criteria include Lead Indicators such as CFSA (Contractor Field safety Audit) score, percentage of workers trained in TPSDI, inspection of critical equipment. Lag indicators such as Fatalities, LWDC and man days lost.
3. The retention amount saved will go to a separate Safety Improvement Fund. Division can use this fund for safety intervention project, process improvement, skill development other than L1, L2, L3 training. This retention amount will be auto released as soon as contract will be closed by order manager
4. For the contract value of more than Rs 1 Cr or contract duration more than 12 months, the retention amount shall be released half yearly based on safety performance. For all remaining contracts, the retention amount will be released with the final bill.
5. In case of job stoppage due to safety violations / unsafe observations at the site, no time extension shall be given to the contractor, if such delays are attributable to contractor.
6. In case of fatality, limb loss or loss of property, vendor must pay for liability, legal, statutory and additional mutually agreed settlement charges imposed by the appointed committee. This charge is over and above the retention amount.
7. The committee will finalize an amount between 5 -50 lakhs based on factors such as advise by statutory authorities, contract value and impact of accident etc.
8. Safety performance bonus 1% (limiting to 50 lakhs) of the invoice value will be considered at the end of the job if the contractual safety performance score 100%.
9. During the progress of the work, concerned Supervisor/Engineer will visit and inspect the work site regularly and evaluate the safety performance of the contractor based on matrix attached herewith and apply the Consequence management policy as applicable.
10. Order Manager, divisional chief and SBU head have the authority to terminate the contract in case of three consecutive serious violations.

Appendix 11: CSM- F-11 Safety Performance Score

Sr. No	Parameter	Unit of Measurement	Target	Weight age	Actual Performance	Actual Score
Lead Indicator						
1	% of Employee certified in TPSDI/Authorized agency	Number	100%	20		
2	Monthly inspection completed for Critical Equipment, lifting Tools & Tackles and hand tools used at site <u>by contractor</u>	Number	80%	15		
3	Condition of critical tools, tackles and equipment <u>to</u>	Number	100%	10		

The Tata Power Company Ltd		<i>Contractor's Safety Code of Conduct</i>
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

	<u>be checked by order manager</u>					
<u>4</u>	<u>Safe (designated way) Disposal of Waste generated</u>	-				
<u>5</u>	<u>Records of waste (Hazardous Waste – Oily cotton waste – E- waste etc.) generation</u>			<u>10</u>		
<u>6</u>	<u>No Effluents to drain</u>					
<u>7</u>	<u>No effluents/discharges to ground</u>					
Lag Indicator						
1	Number of Fatalities	No	0	<u>15</u>		
2	Number of Lost workday case (LWDC) (reportable)	No	0	10		
3	<u>Numbers of total reportable cases</u>	<u>No</u>	<u>0</u>	<u>10</u>		
4	Man-days Lost	Man-days	0	10		
					Final Score	
					Invoice Value	
					Amount to be released	

Safety Performance Evaluation Criteria

Lead Indicators

	Target		
% of Employee certified in TPSDI/Authorized agency	50%	100%	Less than 100%
Score		20	Pro-Reta
	Target		
Monthly inspection completed for Critical Equipment, lifting Tools & Tackles and hand	>=80%	79 to 50%	<50%

The Tata Power Company Ltd		<i>Contractor's Safety Code of Conduct</i>
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

tools used at site <u>by contractor</u>			
Score	15	7	0
	Target		
Condition of critical tools, tackles and equipment <u>to be checked by order manager</u>	100%	<100%	
Score	10	0	
	Target		
<u>Safe (designated way) Disposal of Waste generated Records of waste (Hazardous Waste – Oily cotton waste – E-waste etc.) generation No effluents/discharges to ground</u>	100%	<100%	
Score	10	0	

Lag Indicators

Number of Fatalities	0	>0	
Score	15		0
Number of LWDC (reportable)	0	>0	
Score	10		0
<u>Numbers of total reportable cases</u>	<u>10</u>		<u>0</u>
<u>Score</u>	<u>0</u>		<u>≥0</u>
Number of man days lost	0	1 to 5	>5
Score	10	5	0

The Tata Power Company Ltd		<i>Contractor's Safety Code of Conduct</i>
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

Appendix 12: CSM-F-12 Safety Potential Evaluation Criteria for Vendor Registration

At the time of vendor registration, vendor will be registered under 3 categories

- 1) **Category A**- Vendors eligible to carry out High risk Jobs
- 2) **Category B**- Vendors eligible to carry out technical jobs that are low risk
- 3) **Category C**- Vendors eligible to carry out administrative and office jobs
- 4) **Category D**- Outsourced Jobs / Consultants /Medical Practitioners / Suppliers etc

For vendors to be registered under **Category A**, a safety potential evaluation will be carried out based on following parameters.

Sr. No	Description	Weight	Actual	Remarks
		age (%)	Score	
1	Does the contractor have a valid ISO 45001/ OHSAS 18001/ Certification?	30		
2	During site visit check for safety adequacy at site	30		Annexure - 12.1
3	Check the Safety statistics of Contractor	10		Annexure - 12.2
4	Check the Safety orientation & training process of Contractor	15		Annexure 12.3
5	Check the organizational structure for safety professionals & engineers / supervisors.	10		Annexure - 12.4
6	Certified/skilled workers as a percentage of overall workforce	5		
	Total	100		

Evaluation Criteria for Category B

Sr. No	Description	Weight	Actual	Remarks
		age (%)	Score	

The Tata Power Company Ltd		<i>Contractor's Safety Code of Conduct</i>
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

1	Does the contractor have a valid ISO 9001 certification?	30		
2	During site visit check for safety adequacy at site	30		Annexure -12.1
3	Check the Safety statistics of Contractor	10		Annexure -12.2
4	Check the Safety orientation & training process of Contractor	15		Annexure -12.3
5	Check the organizational structure for safety professionals & engineers / supervisors.	10		Annexure -12.4
6	Certified/skilled workers as a percentage of overall workforce	5		
	Total	100		

Evaluation Criteria for Category C

Sr. No	Description			Remarks
		Weight age (%)	Actual Score	
1	Does the contractor have a valid ISO 9001 certification?	40		
2	Check the Safety statistics of Contractor	40		Annexure - 12.2
3	Check the Safety orientation & training process of Contractor	20		Annexure - 12.3
	Total	100		

Annexure 12.1: Evaluation Criteria for Category D:

Category D does not require any evaluation as it is for outsourced job outside the Tata Power company premise.

Annexure 12.2

The Tata Power Company Ltd		<i>Contractor's Safety Code of Conduct</i>
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

Check List – Adequacy of Safety Statistics of Service Provider				Actual Marks obtained	Remarks
1	Check the safety statistics for last 3 years (LTIFR and LTISR)	Statistics available	Marks 5		
		Statistics not available	0		
2	Check the trend LTIFR for last 3 years	LTIFR value	Marks		
		0 to 0.2	5		
		0.21 to 0.3	2.5		
		>0.3	0		
3	Check the trend of LTISR last 3 years	LTISR value	Marks		
		0 to 2	5		
		2 to 3	2.5		
		>3	0		
4	Has there been any Prosecution/Conviction for any contravention with regard to Safety & Health provisions under the Factories Act /Electricity Act/ BOCW Act and Rules framed there under?		Marks		
		No Prosecution	10		
		Prosecution	0		
		To be provided in written on letter head			
	Total	25			

Annexure 12.3

Check List – Adequacy of Safety orientation & training process of Service provider				Actual Marks obtained	
1	Records of safety trainings provided to safety officer/supervisor/workmen during last 1 year as percentage(%) of total employed by service provider	Safety Officer		Marks	
		≥80% of employees		5	
		50 to 79 % of employee		2.5	
		<50%		0	
		Safety Supervisor		Marks	
		≥80% of employees		10	
		50 to 79 % of employee		6	
		<50%		0	
		Workmen		Marks	
		≥80% of employees		10	
		50 to 79 % of employee		6	
		<50%		0	
	Total	25			

Annexure 12.4

The Tata Power Company Ltd		<i>Contractor's Safety Code of Conduct</i>
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

Check List – Adequacy of organizational structure for safety professionals & engineers / supervisors.				Actual Marks obtained
1	Check availability of number of safety officers from government recognized institute as per workforce strength.		Marks	
		1 in 50 employees	10	
		1 in 100 employee	6	
		Any other	0	
3	Check availability of qualified workforce from government recognized institute/TPSDI.		Marks	
		100% of safety officers qualified	5	
		50 – 99% of safety officers qualified	3	
		<50	0	
	Total	15		

Appendix 13: CSM-F-13 Safety Bid Evaluation Criteria.

The User must select whether the job is high risk/ long duration at time of raising the PR.

- 1) The decision whether job is “**high risk**” or not has to be made by order manager based on Risk involved (Risk Priority Number in HIRA) of the Jobs. An indicative list of high-risk jobs is attached as annexure
- 2) If a technical job is of low risk with estimated duration of the contract is 1 year or more the job should be treated as “**long duration**”.
- 3) All Safety bids will be evaluated by Safety Concurrence Group. Structure of SCG will be declared by Corporate safety. Corporate safety team will audit bid evaluation process of a few selected jobs and Quality of evaluated safety Bids.
- 4) Records of jobs sent by for Safety Bid evaluation shall be maintained by Corporate Contract team in existing tracing sheet along with other jobs.
- 5) For Safety Bid Evaluation will be based on following parameters.

		Minimum Requirement	Weight age (%)	Score Obtained
Manpower	Safety Officer (1 per 500 workers)	Qualification- Officer shall possess Advance Diploma In Industrial Safety by state technical board. Experience- Minimum 1-year experience in relevant field as mentioned in the job in PR.	5	
	Safety Supervisor (1 per work site up	Qualification- Supervisor shall possess ITI/ Diploma in relevant field.	5	

	to max. 50 workers)	Experience- Minimum 2-year experience in relevant field as mentioned in the job in PR. Training – Trained and certified by TPSDI or equivalent institute in applicable safety training. Note: On request of the contractor/Users -TPDSI should vet & certify the skilled & experienced Technician if Technical Qualification is not adequate.		
	Technician (Skilled workers as electrician, rigger, fitter, welder, cable jointer, line men etc.)	Experience- Minimum 2-year experience in relevant field as mentioned in the job in PR. Training – Trained and certified by TPSDI or equivalent institute in basic and relevant safety procedures training.	5	
Tools & Tackles	Equipment / Machines/ Tools & Tackles (lifting and shifting tools)	The list of Equipment /Machines / Tools and tackles to be used for job to be submitted by the contractor. Evaluation of the list will be carried out based on 1) Suitability as per the relevant job 2) Make and age of the tools from authorized agencies defined by the user. 3) Certification by the competent authority of respective state.	30	
Safety Records	Safety Records	Safety Records for last 3 years (as per vendor or as per our knowledge) – Recommendation?	15	
Safety Plan	HIRA/Contract Job Safety Plan	Adequacy of HIRA and Job Safety Plan with respect to relevant job. More weight age will be given to vendor for using mechanized work and advanced tools and equipment	20	
Accredited Bodies certificate	ISO-9001	ISO-9001	2	
	ISO-14001	ISO-14001	3	

The Tata Power Company Ltd		<i>Contractor's Safety Code of Conduct</i>
Document No. TPSMS/GSP/CSM/015 REV 06		Date of Issue: 15/08/2021

	OHSAS 18001 ISO 45000	OHSAS 18001/ISO 45000	15	
		Total Score		

6) Vendor entitled to carry out the job only when qualified for the safety evaluation as follows:

Contractor is qualified in safety bid only if his total score is more than 70% in all category 1 jobs such as high risk/long duration.

7) The Corporate Contract has to ensure that the vendor provides the filled "Safety Competency Form" along with the quotation.

8) Corporate Contract will forward the Safety Competency Form received from the contractor to the Safety Concurrence Group for evaluation.

9) In case SCG wants to visit the site, the Safety Competency will be based on evaluation at the time of site visit Annexure 13.1

Annexure -13.1:

Checklist to be used: During site visit to check the adequacy Safety systems.			
		Observation	Score* (1-5)
1	Check the adequacy of safety policy and Safety Management system of the contractor.		
2	Does the contractor have written down safety procedures?		
3	Check the records of Near miss, unsafe act, unsafe conditions and incidents.		
4	Check the organization setup to implement the safety systems at site (safety officer, safety supervisor)		
5	Check whether safety meeting and toolbox talk carried out regularly and records maintained or not.		
6	Is the process of incident investigation adequate or not?		
7	Verify incident reporting and recording system		
8	Check the usage of equipment/tools and tackles.		
9	Check for housekeeping at site		
10	Check the use of PPEs and general behavior of workforce towards safety		
	Total Score		
	Site Visit Score		

Score*- rating on the scale of 1-5 to be given based on the observations on site. Score of 1 is the lowest and core of 5 is the highest.

Appendix 14: Indicative List of High-Risk Jobs

To access the exhaustive list of High-risk jobs, please refer the following documents

- 1) High Risk Jobs- Generation
- 2) High Risk Jobs- T&D
- 3) High Risk Jobs- Renewable

Indicative List of High-Risk Jobs -Generation Cluster

Sl. No.	Jobs				
1	Demolition / Painting of Chimney				
2	Survey Sounding Jobs in Sea				
3	Dredging at Coal Birth Jetty				
4	Maintenance / Testing and Replacement of Extra High Voltage (132 KV etc.) Switchyard equipment				
5	Maintenance of EOT Cranes				
6	Deep excavation (5 feet or more) near existing buildings /Structure s				
7	Working inside confined spaces (entry through manhole)				
8	Operation Maintenance of elevators				
9	Working on Live control Circuits for identification of faults				
10	Cable laying and termination Jobs				

Indicative List of High-Risk Jobs - T&D Cluster

Sl. No.	Jobs				
1	Transmission Line Tower Erection on columns, near live lines, In congested areas, In creeks, In the Sea				
2	Conductor Stringing on Tower Using Tensioner & Puller in the area such as Line Crossing, Near Live lines, Congested Areas, Road Crossing, Bridge Crossing, Railway line Crossing, In creeks ,In the Sea				
3	Cable Pulling by Using winch Machine in City and Rural Areas				
4	Hot Washing of HT and Extra HT lines, Towers and switchyards equipment				
5	Installation of Lifts				
6	Installation of EOT Cranes				
7	Tower Dismantling				
8	Working on H Frame /Pole mounted Transformers				
9	Excavation in operational Area heaving power cables in receiving station				
10	Identification and spiking of cable / disconnection of cables from poles				

Indicative List of High-Risk Jobs - Renewable Cluster

Sl. No.	Jobs				
1	Working on Electrical Panels				
2	Hi Potting of Equipment				

3	Battery commissioning and maintenance					
4	Working on the nasal of Wind Turbine					
5	Working on live electrical switchyard, material Handling and Equipment installation					
6	Roof Top Solar Panels Installation and maintenance					
7	Working in live Electrical Switchyard, Material Handling, equipment installation					
8	All maintenance activities that requires climbing on Towers /Structures / Transformer/ GODs					
9	Loading and Unloading of Solar Panels on trucks					
10	Structural Repair /Dismantling work at height.					